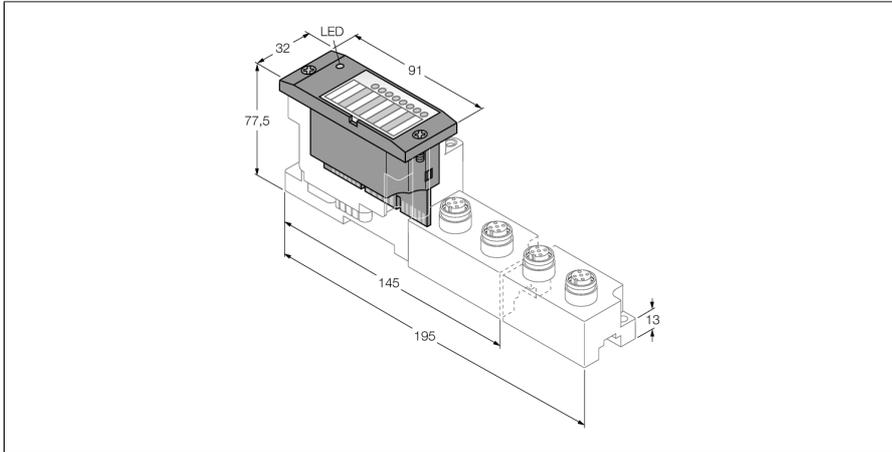


BL67 electronic module

2 Analog Inputs for Pt and Ni Sensors

BL67-2AI-PT



- Independent of the fieldbus and connection technology used
- Protection class IP67
- LEDs indicate status and diagnostic
- Electronics galvanically separated from the field level via optocouplers
- 2 analog inputs for
 - Pt100, Pt200, Pt500 and Pt1000
 - Ni100 and Ni1000
 - 0...100, 0...200, 0...400 and 0...1000 Ω

Functional principle

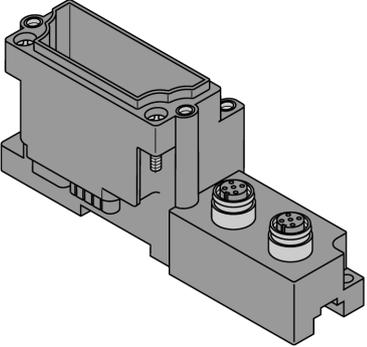



BL67 electronic modules are plugged on the purely passive base modules which in turn are connected to the field devices. The separation of connection level and electronics simplifies maintenance considerably. Flexibility is enhanced because the user can choose between base modules with different connection technologies.

The electronic modules are completely independent of the higher level fieldbus through the use of gateways.

| | |
|-----------------------------------|---|
| Type | BL67-2AI-PT |
| ID | 6827177 |
| Number of channels | 2 |
| Supply voltage | 24 VDC |
| Nominal voltage V_i | 24 VDC |
| Nominal current from field supply | ≤ 30 mA |
| Nominal current from module bus | ≤ 45 mA |
| Power dissipation, typical | ≤ 1 W |
| Inputs | |
| Input type | Pt100, Pt200, Pt500, Pt1000, Ni100, Ni1000, 0...100 Ω, 0...200 Ω, 0...400 Ω, 0...1 kΩ |
| Output connectivity | M12 |
| Linearity | ≤ 0.1 % |
| Basic fault limit at 23 °C | < 0.2 % |
| Repeatability | 0.05 % |
| Temperature coefficient | < 300 ppm/°C of full scale |
| Resolution | 16 Bit |
| Measured-value display | 16 bit signed integer 12 bit full range left justified |
| Number of diagnostics bytes | 2 |
| Number of parameter bytes | 4 |

| | |
|-----------------------------------|---|
| Dimensions (W x L x H) | 32 x 91 x 59 mm |
| Approvals | CE, cULus |
| Ambient temperature | -40...+70 °C |
| Storage temperature | -40...+85 °C |
| Relative humidity | 5...95 % (internal), level RH-2, no condensation (when stored at 45 °C) |
| Vibration test | Acc. to EN 61131 |
| - up to 5 g (at 10 to 150 Hz) | for mounting on DIN rail no drilling according to EN 60715, with end bracket |
| - up to 20 g (at 10 up to 150 Hz) | for mounting on base plate or machinery Therefore every second module has to be mounted with two screws each. |
| Shock test | Acc. to IEC 60068-2-27 |
| Drop and topple | acc. to IEC 68-2-31 and free fall to IEC 68-2-32 |
| Electromagnetic compatibility | Acc. to EN 61131-2 |
| Protection class | IP67 |
| Tightening torque fixing screw | 0.9...1.2 Nm |

Compatible base modules

| Dimension drawing | Type | Pin configuration |
|---|--|---|
|  | <p>BL67-B-2M12 6827186 2 x M12, 5-pole, female, a-coded</p> <p>Comments do not connect Pin 3. Use only sensor cables without pin 3 or field-wireable connectors!</p> | <p>Pin Assignment</p>  <ul style="list-style-type: none"> 1 = S + 2 = PT + 3 = GND 4 = PT - 5 = PE <p>2-wire Connection</p>  <p>3-wire connection</p>  |

LED display

| LED | Color | Status | Meaning |
|----------------------|-------|-------------------|---|
| D | | OFF | No error message or diagnostics active. |
| | RED | ON | Failure of module bus communication. Check if more than 2 adjacent electronic modules are pulled. Relevant modules are located between gateway and this module. |
| | RED | FLASHING (0.5 Hz) | Upcoming module diagnostics |
| AI channels 0 / 1 | | | Without function |

Data mapping

| DATA | BYTE | Bit 7 | Bit 6 | Bit 5 | Bit 4 | Bit 3 | Bit 2 | Bit 1 | Bit 0 |
|-------|------|----------|-------|-------|-------|-------|-------|-------|-------|
| Input | n | AI 0 LSB | | | | | | | |
| | n+1 | AI 0 MSB | | | | | | | |
| | n+2 | AI 1 LSB | | | | | | | |
| | n+3 | AI 1 MSB | | | | | | | |

n = Offset of input data; depending on extension of station and the corresponding fieldbus.

m = Offset of output data; depending on extension of station and the corresponding fieldbus.

With PROFIBUS, PROFINET and CANopen, the I/O data of this module is localized

within the process data of the whole station via the hardware configuration tool of the fieldbus master.

With DeviceNet™, EtherNet/IP™ and Modbus TCP a detailed mapping table can be created with the TURCK configuration tool I/O-ASSISTANT.